


8523 Hwy 276, Royse City.Contours
Rockwall County, Texas, 206.294 AC +/-

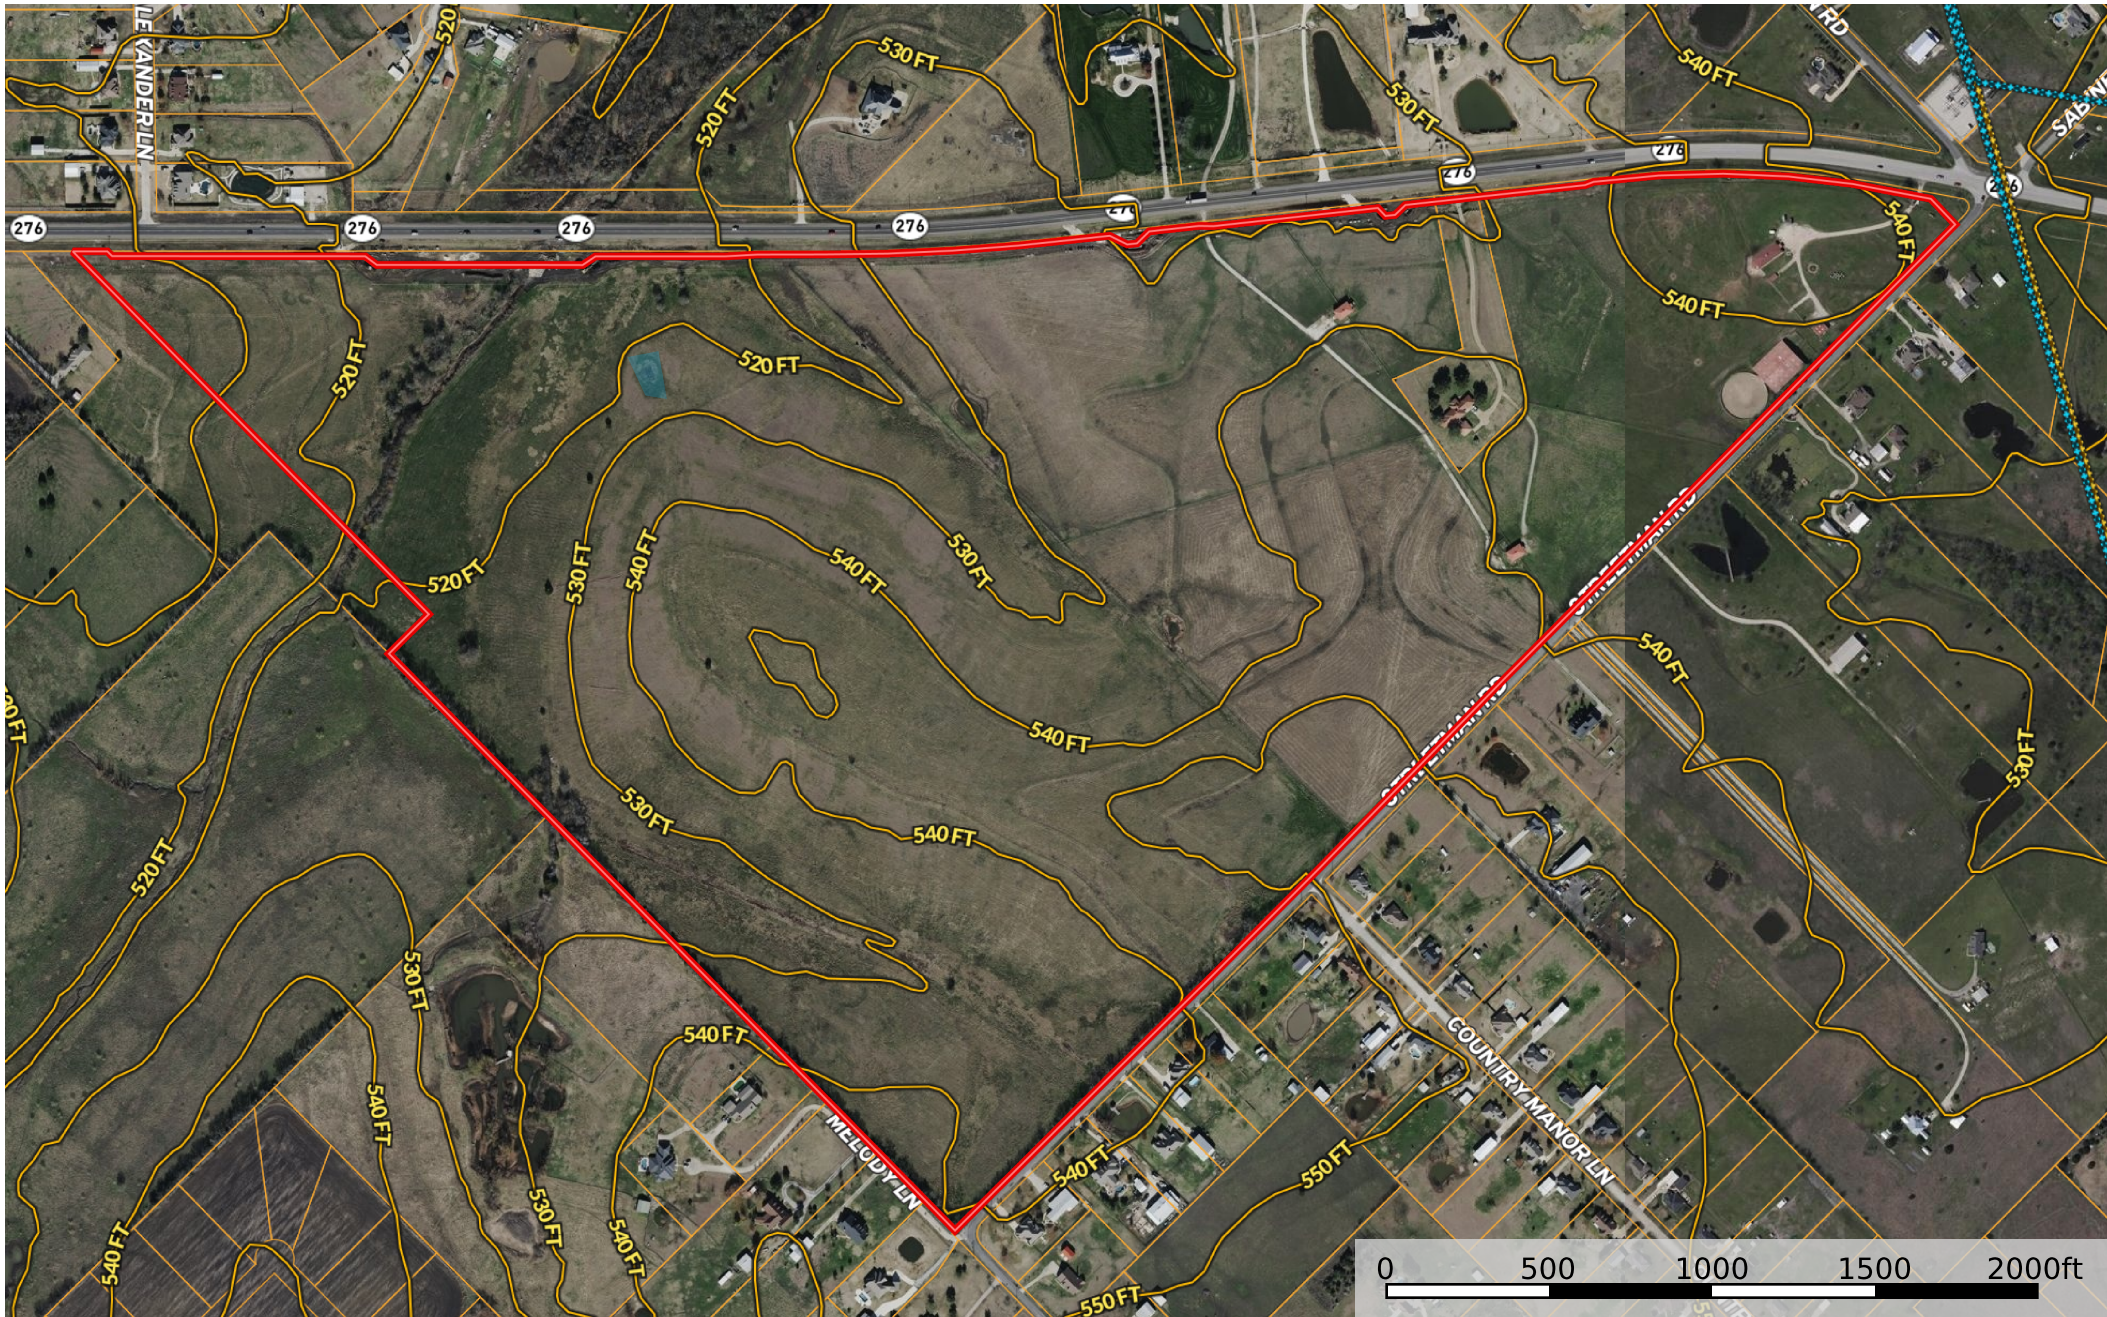

- Pond / Tank
- Boundary
- Voltage Unavailable
- Voltage 0 - 99 KV
- Voltage 100 - 161 KV
- Voltage 220 - 287 KV
- Voltage 345 KV
- Voltage 500 KV
- Voltage 735 KV+