



PERMIT TO CONSTRUCT AND OPERATE
Onsite Wastewater System

File Nbr: **2012070008**
County: Oconee

Name: ANTHONY KADUK

Type Facility: HOUSE

Subdivision: KEOWEE FALLS NORTH

Block: Lot: J 6

Address: 230 EASTATOE PKWY
SUNSET, SC 29685

Site: IVORY BILL WAY
, SC

Program Code: 360

System Code: 380

TM#: 039-01-02-033

Water Supply: PUBLIC

PERMIT TO CONSTRUCT SYSTEM SPECIFICATIONS

Daily Flow (gpd): 480

Tank Sizes (gal): Septic Tank: 1000

Pump Chamber:

Grease Trap:

LTAR: .40

Trenches: Length (ft): 280

Width (in): 36

Max. Depth (in): 48

Agg. Depth (in): 28

Min Pump Capacity:

gpm at

ft. of Head

SPECIAL INSTRUCTIONS/CONDITIONS

THIS PERMIT IS SITE SPECIFIC. ANY CHANGES TO THE SYSTEM MUST BE APPROVED BY DHEC.
ANY UNAPPROVED CHANGES WILL VOID THIS PERMIT.

DRAINLINES MUST FOLLOW LEVEL SURFACE CONTOURS - USE STEP-DOWNS BETWEEN LINES AS NEEDED
DRAINLINES TO BE 10+' ON CENTER - SYSTEM MUST BE 5+' FROM FOUNDATION AND PROPERTY LINES
DO NOT DRIVE OR PARK OVER SEPTIC SYSTEM

KEEP SYSTEM 50+' FROM LAKE AT ALL POINTS


KEEP DRAINLINES 25+' FROM GULLY

* PROBABLE ROCK - SYSTEM MUST BE INSTALLED BEFORE BUILDING HOUSE *

PERMIT TO CONSTRUCT SYSTEM DIAGRAM

1.48 AC

(NTS)

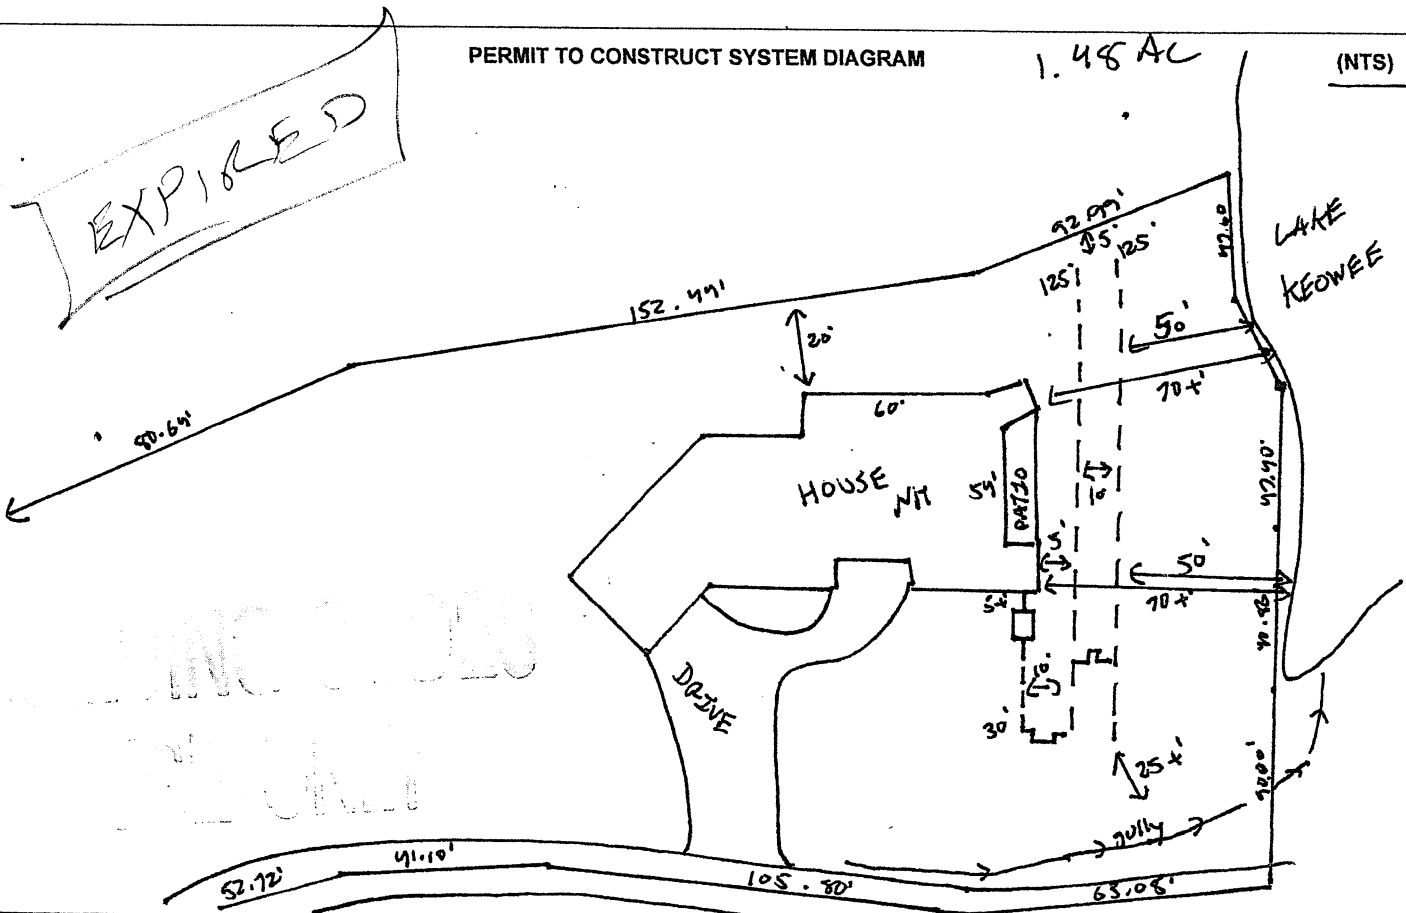

Issued/Revised By: Th. D. Shipe

Date: 8/13/12

DHEC 1781 (8/4/2008)

This Permit is Appealable Under the Administrative Procedures Act.
This Permit will Expire and Become Null and Void Five (5) Years from the Issuance Date.
There may be an Additional Fee for Changes in this Permit that Require a Site Reevaluation.